


**NOTES:**

1. AUDIBLE AND VISIBLE ALARM ACTIVATED WHEN SHOWER OR EYEWASH IS IN USE.
2. 120VAC SUPPLY VOLTAGE REQUIRED, APPROXIMATELY 100VA ALL ELECTRICAL HOOKUPS TO MAIN JUNCTION BOX.
3. SYSTEM CERTIFIED AS SUITABLE FOR CLASS I, DIV. 2 GROUPS B, C, D LOCATION INSTALLATION. INSTALLER MUST USE THREAD SEALANT, SUCH AS APPLETON TLC3, RECOMMENDED FOR USE IN HAZARDOUS LOCATIONS ON ALL ELECTRICAL NPT CONNECTIONS.

(CONTINUED ON SHEET 2)

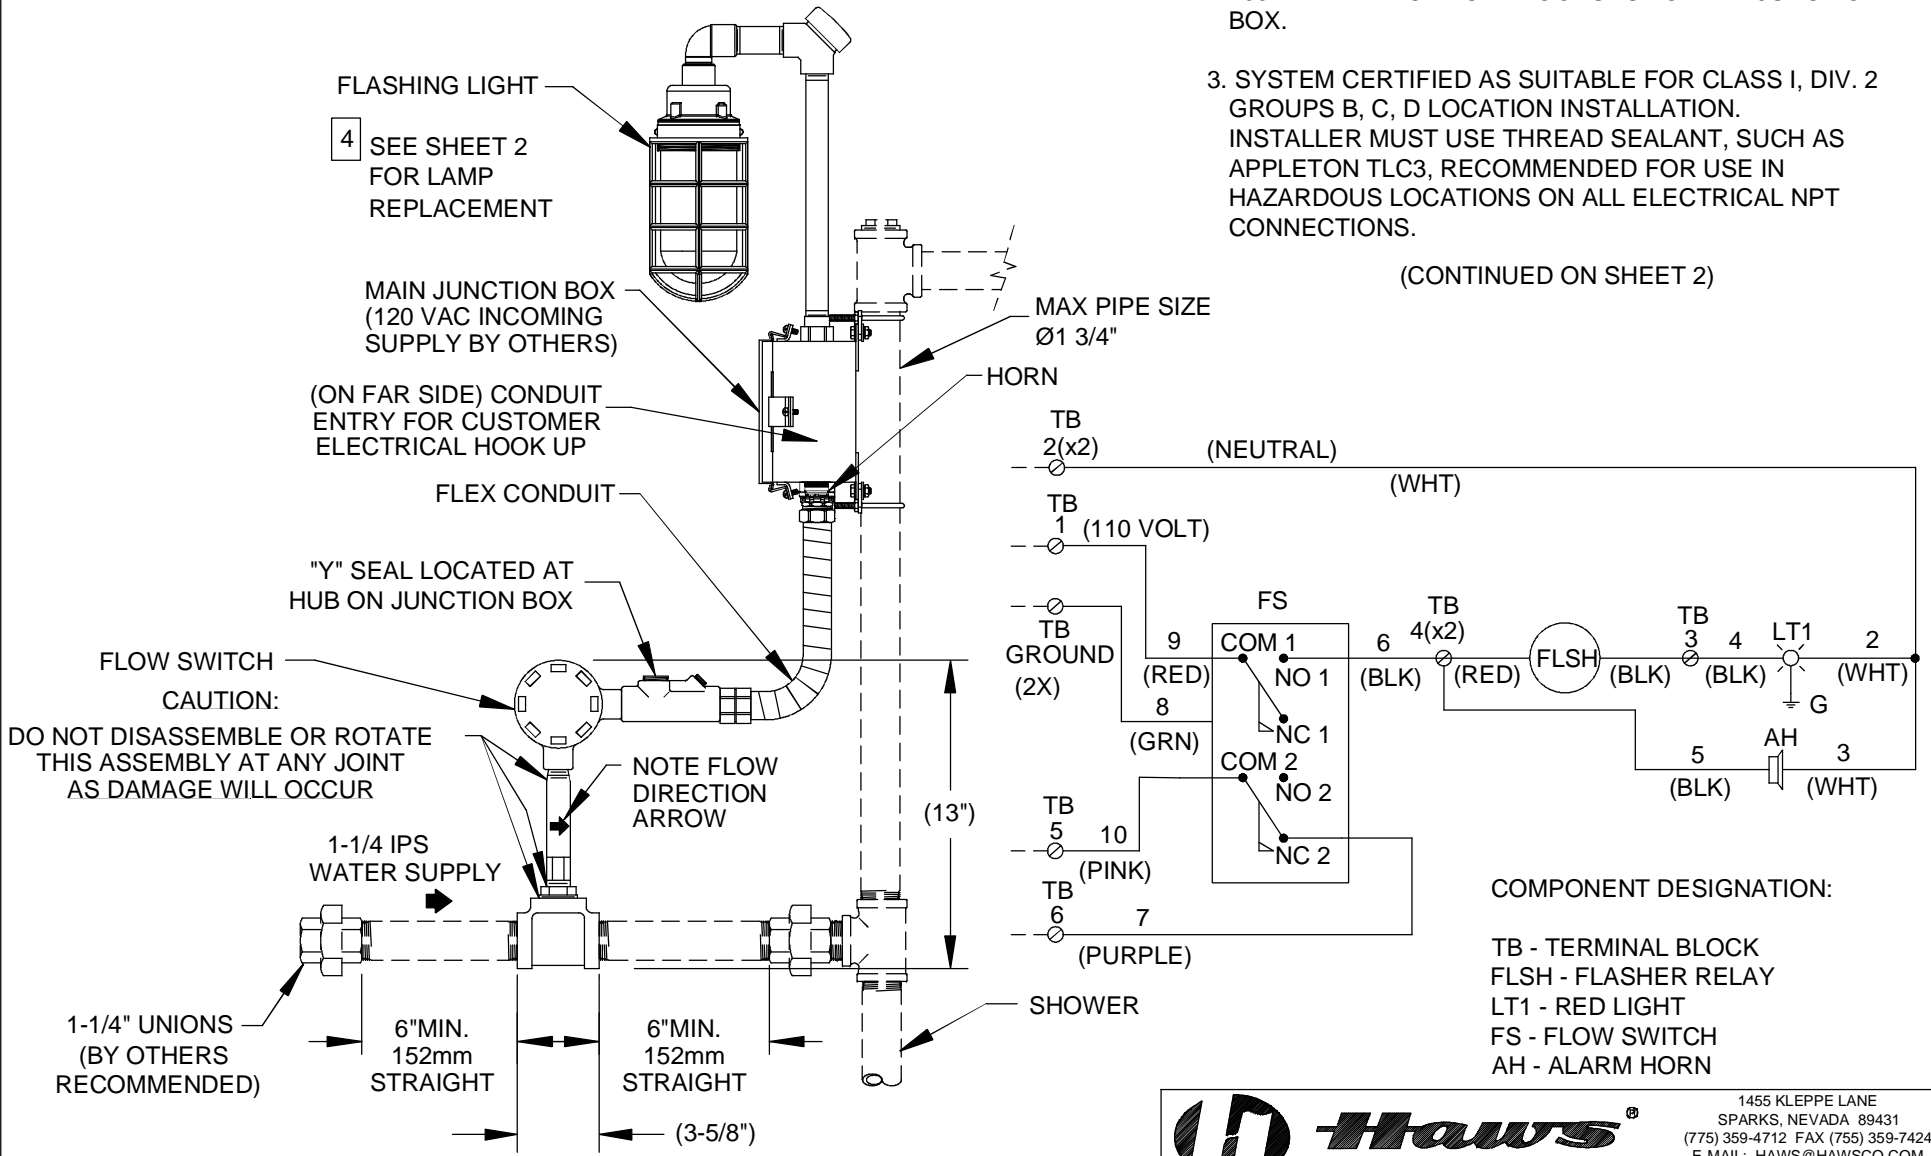

COMPONENT DESIGNATION:

- TB - TERMINAL BLOCK
- FLSH - FLASHER RELAY
- LT1 - RED LIGHT
- FS - FLOW SWITCH
- AH - ALARM HORN



**Haws**

1455 KLEPPE LANE  
SPARKS, NEVADA 89431  
(775) 359-4712 FAX (775) 359-7424  
E-MAIL: HAWS@HAWSCO.COM  
WEBSITE: WWW.HAWSCO.COM

ECN NO.:	REVISED PER BY:	MODEL(S)	PART NUMBER
5087	OYY	9001EXP ALARM	0002080203.D
DRAWN: CJL	DATE: 06/91	CHK'D:	DRAWING NO. REV
APPROVED: FV	DATE: 06/07/16	SCALE: 1:1	09648A00 23
DRAWING TYPE: INSTALLATION		SIZE: A SHEET 1 OF 2	

NOTES: (CONTINUED FROM SHEET 1)


4 LIGHT REPLACEMENT INSTRUCTIONS:

1) REMOVE GUARD AND GLOBE:  
FIRST LOOSEN SET SCREW (LOCATED ON GUARD WHERE SHOWN). NEXT, ROTATE GUARD COUNTER CLOCKWISE UNTIL GUARD IS FREE. FINALLY ROTATE GLOBE COUNTER CLOCKWISE UNTIL GLOBE IS FREE AND LAMP IS EXPOSED.

2) REPLACE LAMP WITH RECOMMENDED 130 VOLT, 60 WATT, RED.  
P/N 0003225505

**WARNING - EXPLOSION HAZARD - SUBSTITUTION OF COMPONENTS MAY IMPAIR SUITABILITY FOR CLASS 1, DIVISION 2.**

3) REPLACE GUARD AND GLOBE:  
ROTATE GLOBE CLOCKWISE ONTO THREADS UNTIL SEALED AGAINST GASKET. NEXT, ROTATE GUARD CLOCKWISE ONTO THREADS UNTIL TIGHT. FINALLY TIGHTEN SET SCREW.

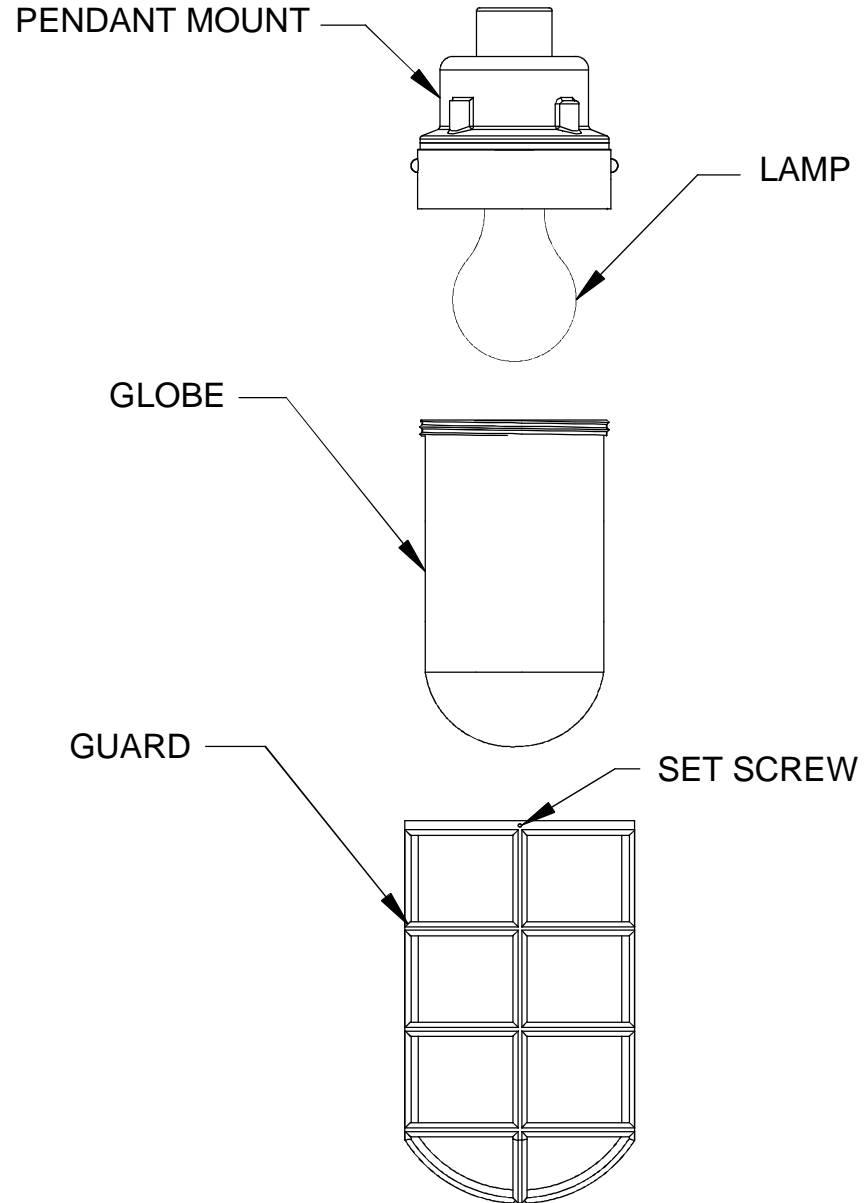

			<b>Haws</b> <sup>®</sup>			1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (755) 359-7424 E-MAIL: HAWS@HAWSCO.COM WEBSITE: WWW.HAWSCO.COM		
ECN NO.	REVISED PER	BY:	MODEL(S)			PART NUMBER		
	ECN: 5087	OYV	9001EXP ALARM			0002080203.D		
DRAWN:	DATE:	CHK'D:				DRAWING NO.		
HM	08/12/09					09468A00		
APPROVED:	DATE:					REV		
FV	06/07/16		SCALE: 1:1			DRAWING TYPE: INSTALLATION		
						SIZE: A SHEET 2 OF 2		