


Property Owner: Barbara Bartley Property Location: Macedonia Rd Application Date: 7/30/09

Directions: Hwy 63 @ Mt. Carmel, straight, @ Jenkins Valley, on R

Subdivision: Maplewood Village Phase/section: _____ Lot# 2 Installer: Kevin King

~~Well Supply~~ Private Well Spring Shared Well Community Min. Required Separation Distance N/A Installed? Yes No

Conditions: 1) Pump septic tank every 3 to 5 years. 2) Divert all gutters and other surface water, away from septic system and repair areas. (3) No cutting or filling over septic system and repair areas.

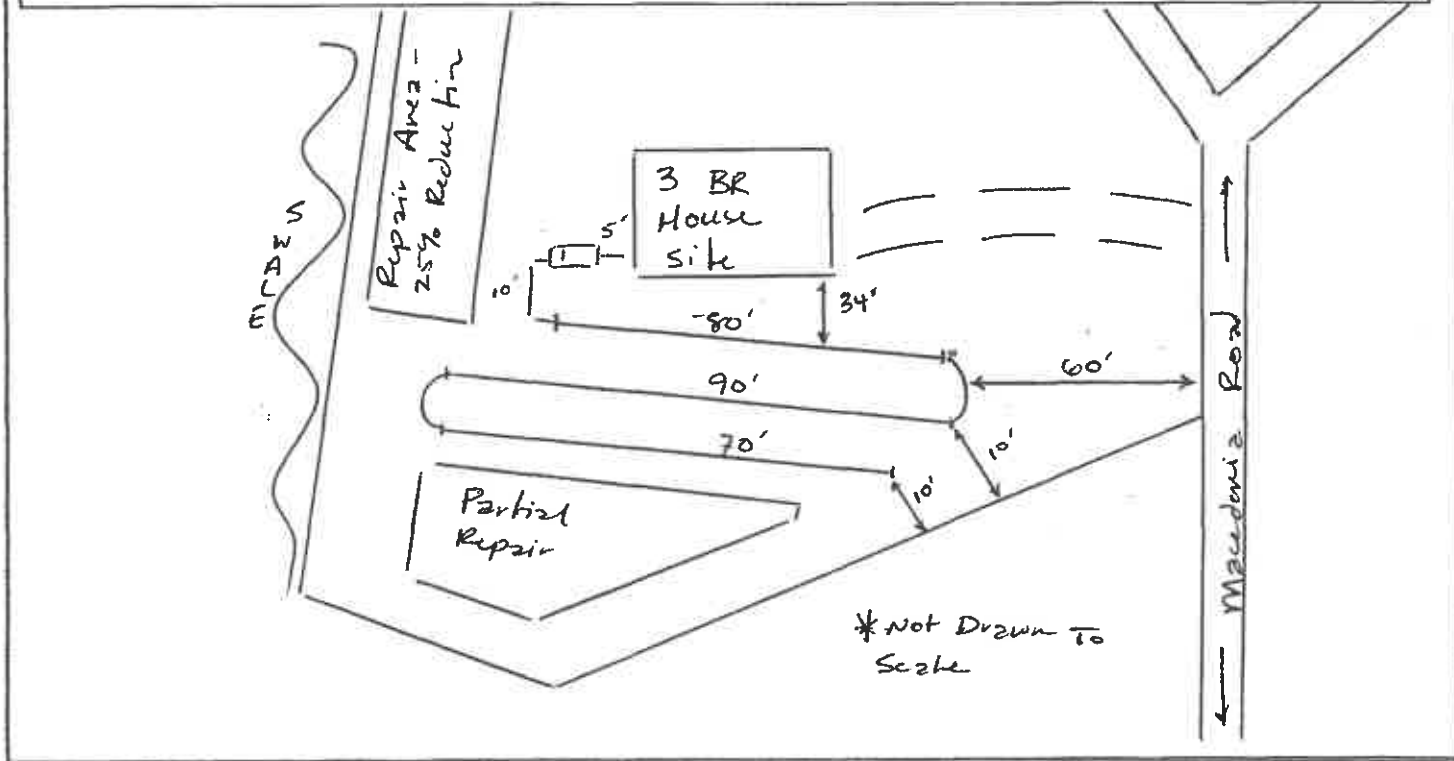

Operations Permit For: New System Repair Revision Drawings, plans, conditions, etc. attached? Yes No

System Approved For: House Mobile Home (single double) Bedrooms: 3 Basement: Yes No Basement Plumbing: Yes No

Multiple Unit Dwelling: No. of Units _____ Number of Bedrooms per unit _____ Business No. Employees: _____ No. Shifts: _____

Operation Description: _____ Industrial Waste: Yes No

Approved Installation Specifications: 360 (GPD) 0.40 System Classification: Type I, II, III G, IV, V, VI

Yes No Pump Make: _____ Model: _____ Serial No. _____

Length: 240 ft No. of Trenches 3 Width: 36 Spacing: 9 ft Depth: 30 in (lower sidewall) Stone Depth: _____ in

Distribution: Equal Gravity Pressure Manifold Serial Dams/Step Downs Septic: 1000 (gallons) Pump Tank: _____ (gallons)

Material: Prefabricated Panel Block Conventional Large Diameter Pipe Chamber Expanded Polystyrene Aggregate Other _____

Inspected by: [Signature] RS Date: 10/2/09 Issued To: Mailed Date: 10-7-09