05070114299

HENDERSON COUNTY DEPARTMENT OF PUBLIC HEALTH
OPERATIONS PERMIT

~~OP No. 0230~~

Owner: Todd Hammond Date: 12-3-03

Building Contractor: 111 Ivy Rd.

Septic Tank Installer: Don Steeles

Lot No. 298 Development: High Vista

Location: High Vista Drive to Henry Lowrey L on Rd Oak, R on Ivy Rd.

House ☒ Mobile Home ☐

Other: —

No. Bedrooms: 3 Design Flow GPD: 360

Lot Size: 1.37

Owner's Signature: Todd Hammond

AC No. ~~40768~~

I No. ~~40768~~

WI No. City

Water Supply: ☐ Community ☐ Shared ☐ Individual ☒ City

Tank Size: 1000 Gal

Drainfield: 900 Sq. Ft.

Stone Depth: NA Inches

System Type: EPS

Min. System Review Frequency: —

Issued By: Victoria W. Young
Environmental Health Specialist

VALID ONLY FOR USE AS DESCRIBED ABOVE
DRAWING NOT TO SCALE

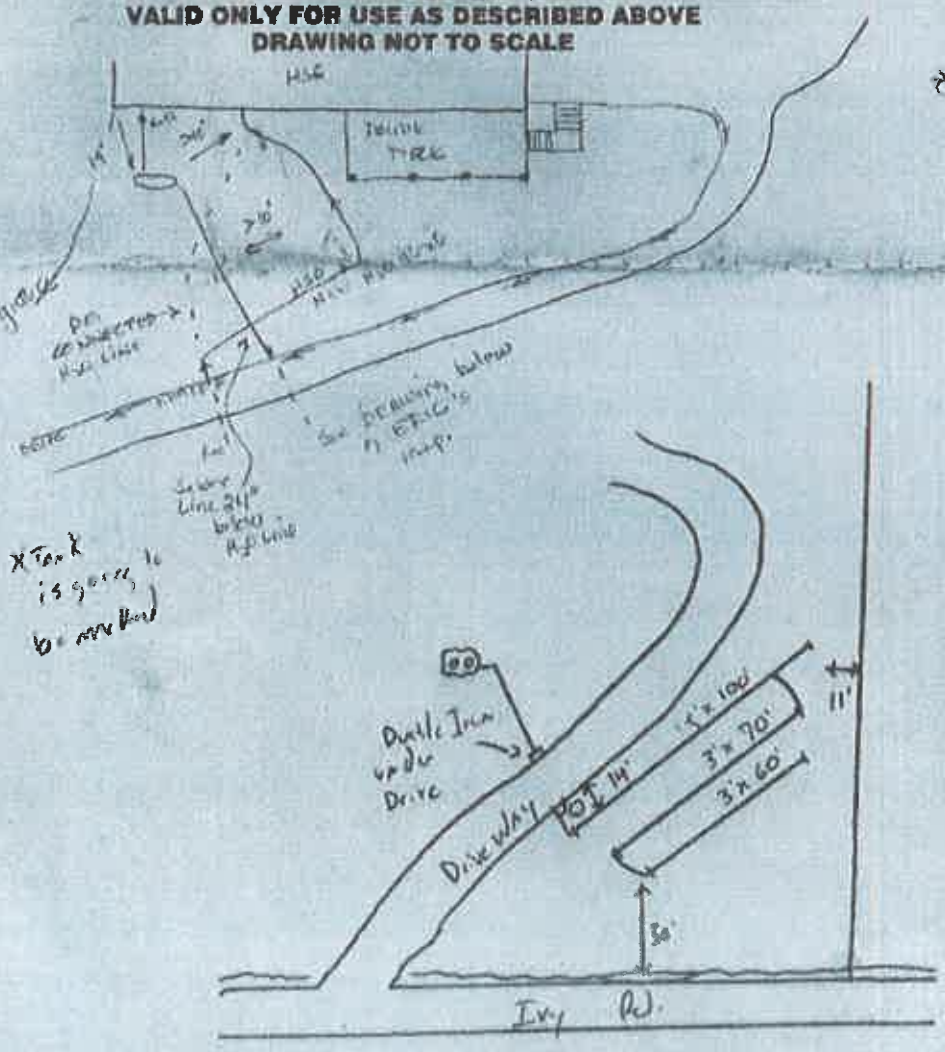

* Tank & Drainfield OK ELP 12-3-03

Supply line needs to be checked ✓ ELP 12-17-03

10/05 Sub for frost heap problem with line

10/26/05 Site visit re: Water line open exposed

10/31/05 Water line Re-Routed >10' off septic >18" below ft line where crosses